


Extinguisher Mounting and Signage Heights

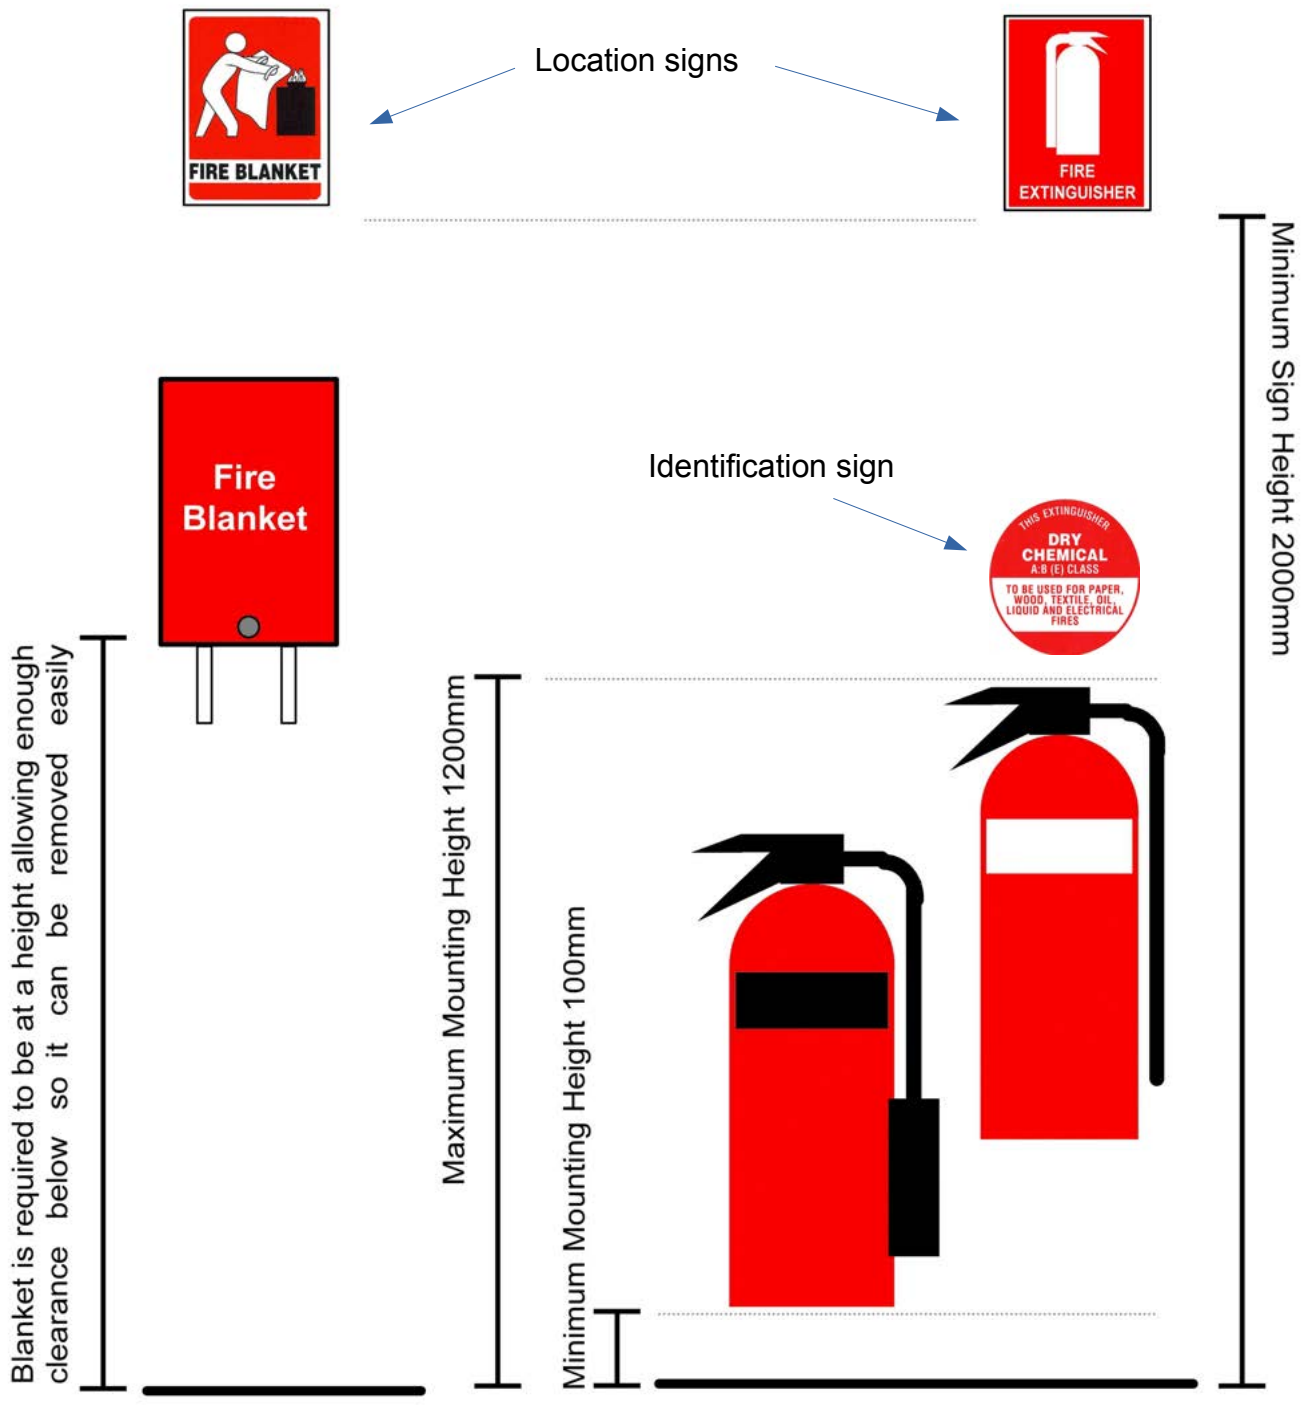

Location signs must be fitted at a minimum height of 2 metres above floor level, or in a location and height that makes it most apparent to a person of average height approaching the extinguisher(s) or fire blanket.

The **location sign** is the only mandatory requirement and does NOT necessarily need to be placed directly above the equipment, but where it will best direct a person to the extinguisher(s) or fire blanket.

Identification signs may be placed directly above that extinguishers hook if deemed necessary by your safety committee/personnel. These are a good idea, especially when two or more extinguishers are placed at the one location.